

**CZ** Návod na použití  
**GB** Instructions for use




<i>maximální teplota</i> <i>maximum temperature</i>	85°C
<i>rozsah regulace</i> <i>control range</i>	20÷65°C
<i>doporučený tlak</i> <i>recommended pressure</i>	1 bar

BAR	průtok l/min. flow rate l/min.				
	Ø				
	SLT 07 3/4"	SLT 08 1"	SLT 09 1"1/4	SLT 10 1"1/2	SLT 11 2"
1	43	53	82	155	212
2	63	75	118	225	300
3	76	92	145	270	370
4	90	108	167	320	430

Může být nainstalován s nastavitelnou částí směrem dolů.


Could be installed downwards by adjustable part.

**CZ** Schéma instalace bez zpětného okruhu  
**GB** Installation diagram without recycling circuit

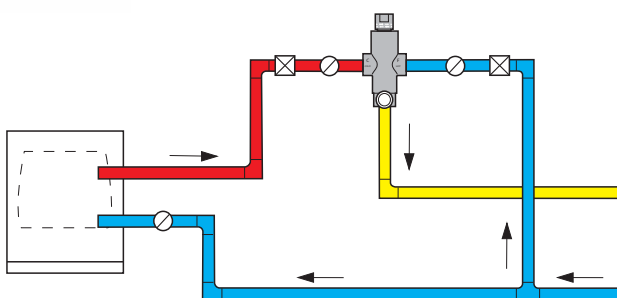


**CZ** Schéma instalace se zpětným okruhem  
**GB** Installation diagram with recycling circuit


- ⊙ zpětný ventil, non-return valve
- ⊠ propustný ventil, gate valve
- ⦿ čerpadlo, circulator

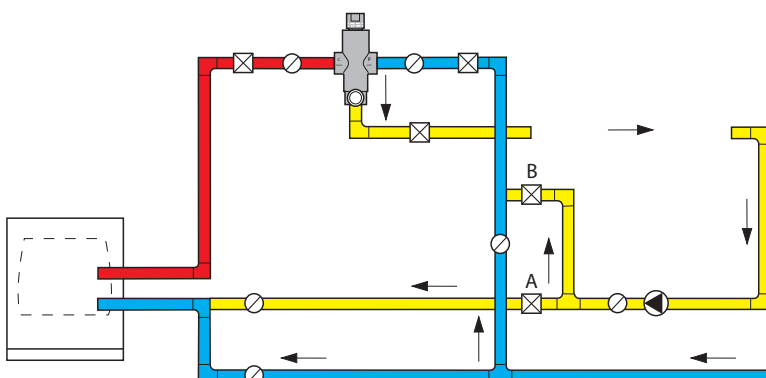

**(CZ) Schéma instalace pro podlahové vytápění**  
**(GB) Installation diagram for floor radiant heating system**

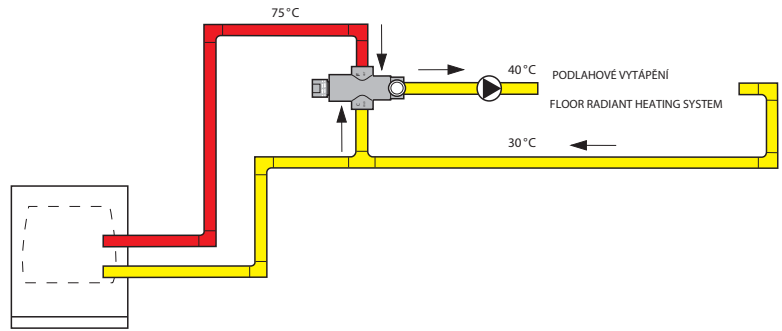

**(CZ) Pokles tlaku / Průtok**  
**(GB) Fall of pressure / rate of flow**

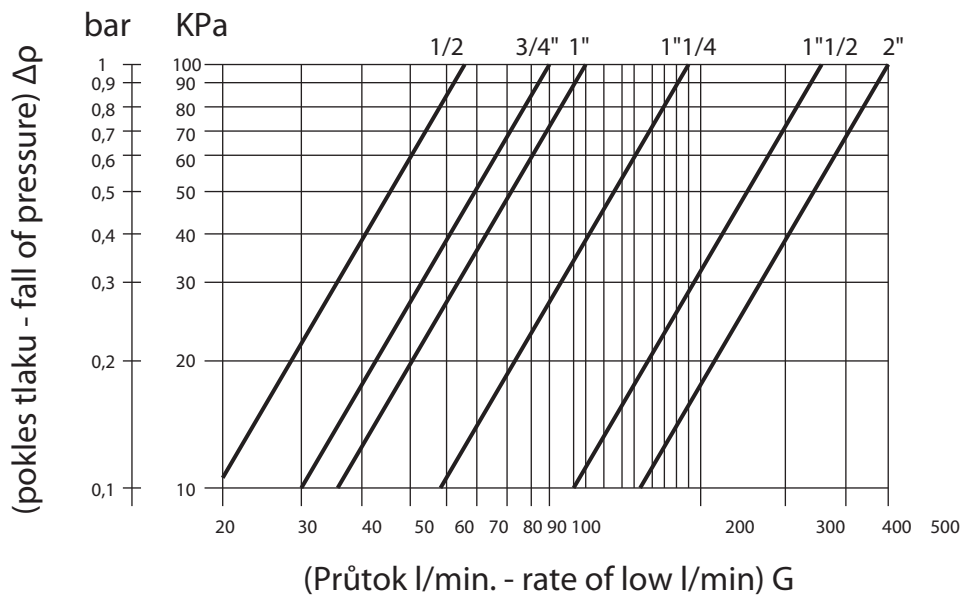


10 KPa = 1 m.c.a. = 0,1 bar

- V návaznosti na normu EN 1111, termostatický směšovací ventil zastaví přívod vody, pokud dojde k přerušení dodávky studené nebo teplé vody. Na vstupech teplé a studené vody musí být umístěn zpětný ventil!
- Nepřipojujte zpětný okruh potrubí přímo na kotel.
- Following the regulations EN 1111, Anti-scalding thermostatic mixing valve stops the water supply if accidentally there is no cold or hot water.
- In all cases, the non-return valve must be fitted to the hot and cold water inlet.
- Do not connect the recycling piping only to the boiler.
- After the circulator, nearly all the mixed water will go the cold water pipe that feeds the mixer whilst a very small part will go to the boiler.

**(CZ) Nastavení**  
**(GB) Setting**

- Během instalace, pusťte studenou vodu do horké vody, aby se ventil vyčistil od případných nečistot.
- Nastavte přinejmenším na polovinu jeden z ventilů na příslušenství, na který má být obvod nastaven a pomocí seřizovacího knoflíku nastavte požadovanou teplotu vody na výstupu termostatického ventilu.
- Přečtěte si nastavení teploty na teploměru na termostatickém ventilu.
- Jestliže je instalace se zpětným okruhem dokončena, nastavte směs vody, vypněte všechny kohoutky příslušenství a počkejte, až teploměr ukáže teplotu ve výstupním okruhu. Pokud je odlišná od teploty stanovené pro smíšenou vodu, musí se vyvážit teplota obvodu pomocí A a B (viz obr.2 strana 1).
- Je-li v výstupním okruhu teplota vyšší, použijte jednocestný ventil ke snížení toku co nejvíce. Viz instalační diagram.
- During installation, turn on the cold water before the hot water to avoid that the cartridge breaks.
- Turn on at least half plus one of the taps on the fixtures that are to be supplied and use the adjusting knob to set the required mixed water temperature.
- Read the temperature setting on the thermometer.
- If recycling circuit has been installed, after setting the mixed water temperature, turn off all the taps and wait until the thermometer shows the temperature of the recycling circuit. If this is different from the temperature set for the mixed water, the circuit must be balanced by means of gate valves A and B. If the recycling circuit temperature is higher, use gate valve A to reduce flow as much as possible.
- See at page with the installation diagram.

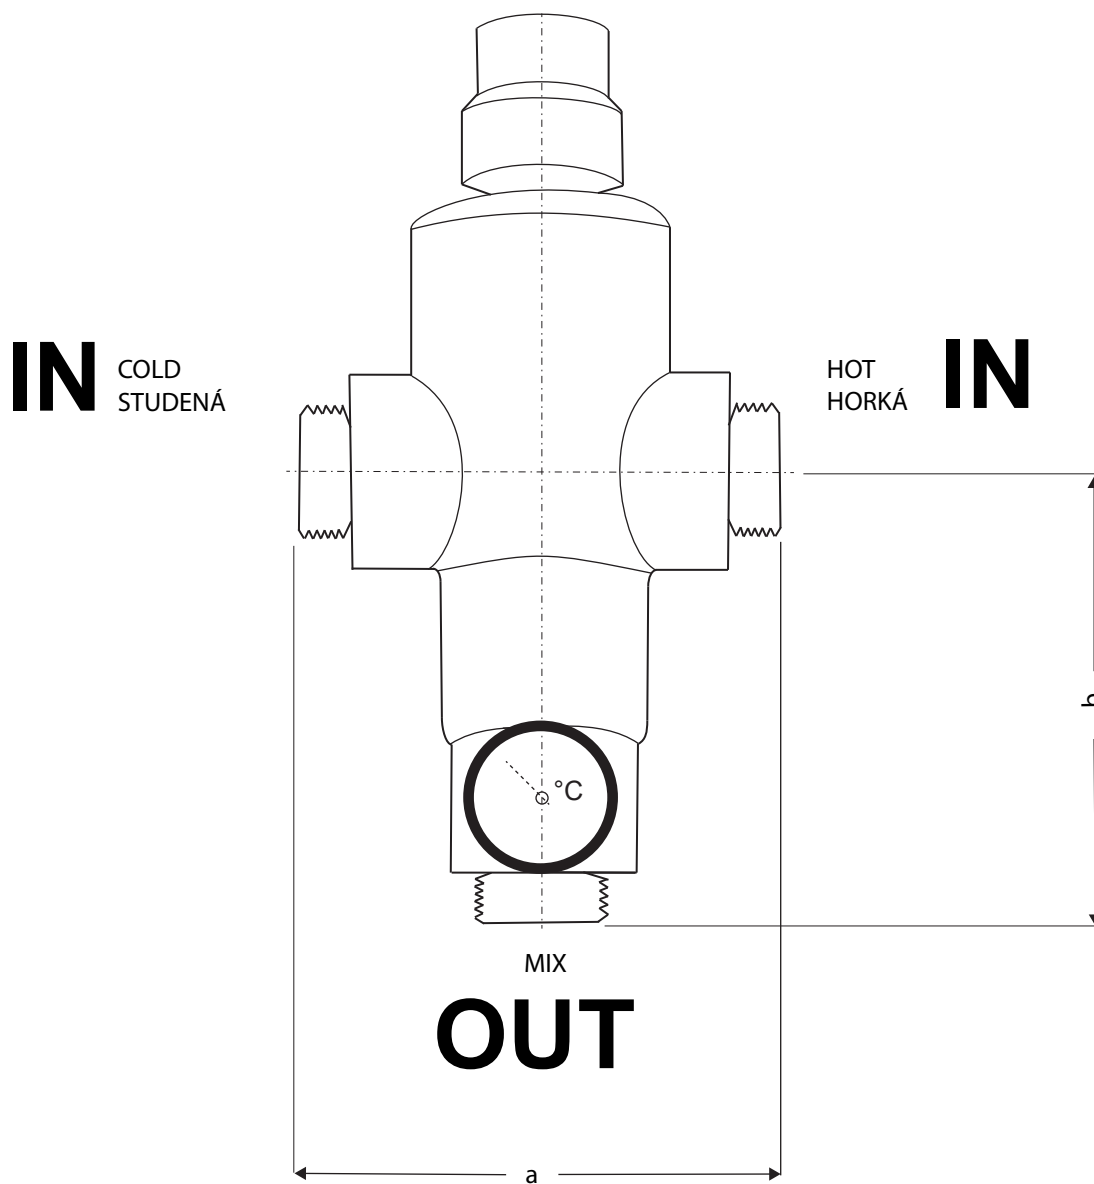

	Ø	a [mm]	b [mm]	
SLT 07	3/4"	98	98	<b>volba teploty přímo ze zabudovaného teploměru</b>
SLT 08	1"	123	118	
SLT 09	1" 1/4	123	118	choice of the temperature directly from immersion thermometer
SLT 10	1" 1/2	182	138	
SLT 11	2"	182	138	